


Skaneateles Lake Water Service Illustration

Illustration is not to scale

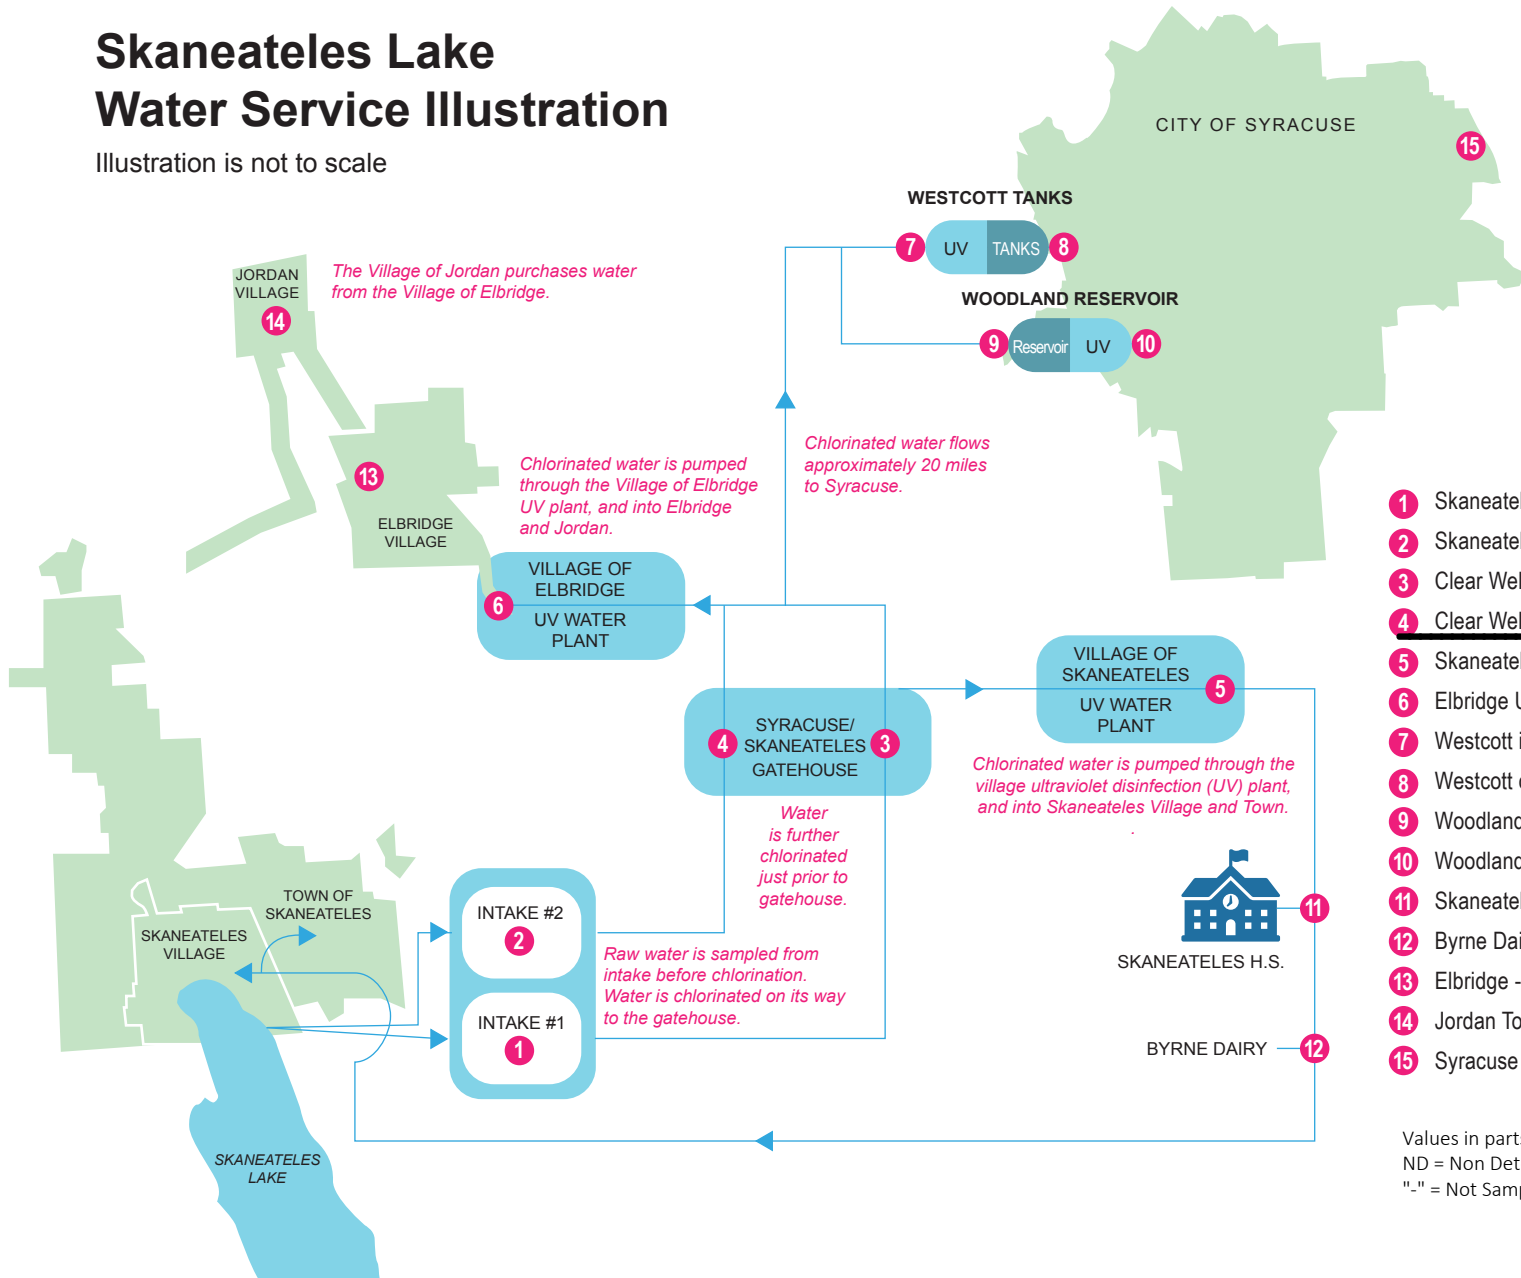

	Date Sampled		
	10/1	9/30	9/29
1 Skaneateles Gatehouse - Intake 1	0.20	0.53	ND
2 Skaneateles Gatehouse - Intake 2	0.33	0.77	ND
3 Clear Well 1 at Gatehouse	ND	ND	ND
4 Clear Well 2/3 at Gatehouse	0.16	0.16	ND
5 Skaneateles UV Plant	ND	ND	ND
6 Elbridge UV plant	ND	ND	ND
7 Westcott incoming	-	-	-
8 Westcott outgoing to Syracuse	ND	ND	ND
9 Woodland incoming	-	-	-
10 Woodland outgoing to Syracuse	ND	ND	ND
11 Skaneateles HS	-	-	-
12 Byrne Dairy	-	-	-
13 Elbridge - North	-	-	-
14 Jordan Town Hall	-	-	-
15 Syracuse - Burnet & Thompson	-	-	-

Values in parts per billion (ppb)

ND = Non Detect

"-" = Not Sampled



Department
of Health